


DIA. OF MAIN (IN.)	FLOW REQUIRED (GPM)	MIN. ORIFICE SIZE (IN.)	RECOMMENDED BLOW-OFF SIZE (IN.)
2	25	0.56	3/4
2 1/2	40	0.71	1
3	60	0.87	1 1/4
4	100	1.10	1 1/2
6	220	0.56	2
8	390	0.71	2 1/2

NOTES:

1. ALL PIPING AND FITTING MATERIALS TO BE BRASS.
2. ALL MATERIAL FOR "BLOW-OFF" TO BE APPROVED BY CITY AT OWNER'S EXPENSE AND TO BE INSTALLED BY CONTRACTOR.


* UNDER MOST SITUATIONS, THE ABOVE TABLE CAN BE USED. BUT, IN SOME AREAS WHERE THE STATIC PRESSURES ARE EXCEEDINGLY HIGH, SMALLER BLOW-OFFS MAY BE NECESSARY.



The Good Life

REVISIONS

NO	DATE	DESCRIPTION

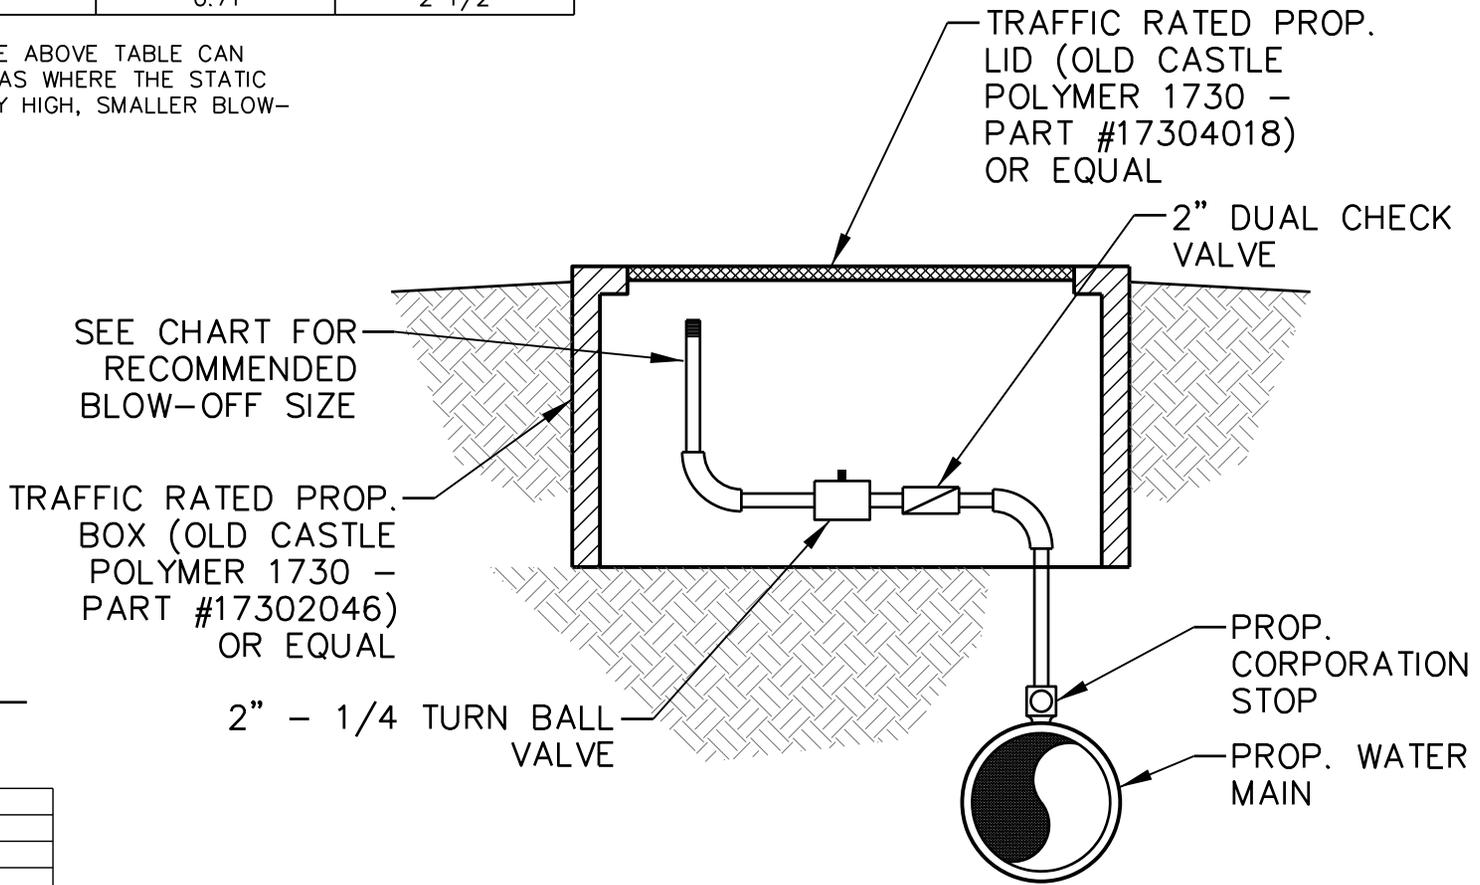

CITY OF TEGA CAY
LAND DEVELOPMENT
STANDARDS

TYPICAL PERMANENT
BLOW-OFF

STD. NO	REV