



SECTION VIEW
N.T.S.

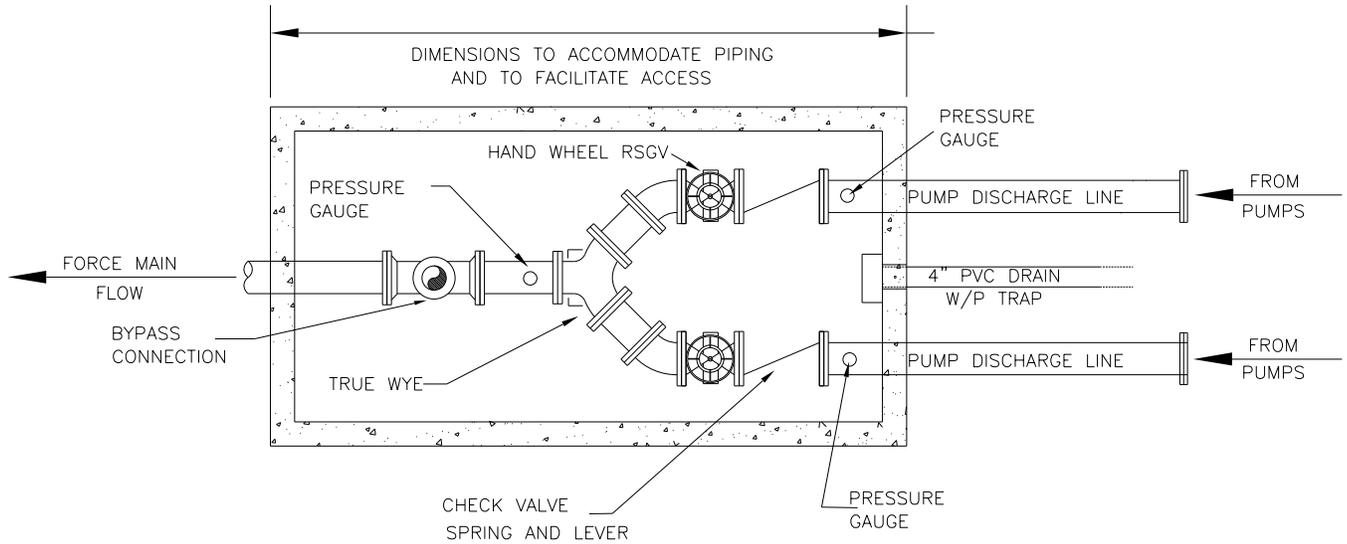

PLAN VIEW
N.T.S.

(FOR SUCTION-LIFT STATIONS, SEE NOTE BELOW)

NOTE: DEPENDING ON THE PUMP STATION MANUFACTURER, SUCTION LIFT PUMP STATIONS MAY HAVE SOME OR ALL OF THE VALVES AND PIPING LOCATED ABOVE GROUND, AS PART OF THE PUMP PACKAGE WITHIN THE ENCLOSURE. HOWEVER, THE BYPASS CONNECTION AND ASSOCIATED VALVE(S) SHALL BE LOCATED WITHIN A SEPARATE VAULT, THE LAYOUT OF WHICH SHALL BE SIMILAR TO THAT SHOWN ABOVE. THE ENGINEER SHALL SUBMIT THE VALVE VAULT AND/OR BYPASS CONNECTION ARRANGEMENT TO THE CITY ENGINEERING DEPARTMENT FOR APPROVAL.



The Good Life

**CITY OF TEGA CAY
LAND DEVELOPMENT
STANDARDS**

**SUBMERSIBLE PUMP STATION
VALVE VAULT W/ BY-PASS
CONNECTION**

SCALE: N.T.S.
REVISION DATE: 7/29/16